
GMLighting®

LineDRIVE™ LD-EDWP-UNV30/60/90 Wet Location Power Supply Installation Instructions

BEFORE YOU START:

- Please check local electrical codes before beginning
- Turn power off before installing
- Make sure to use properly rated wire

NOTE: DO NOT INSTALL IN AN APPLICATION THAT IS OUTSIDE OF THE PRODUCTS LISTED AMBIENT TEMPERATURE OR IN AN AREA THAT IS NOT EASILY ACCESSIBLE FOR SERVICE REQUIREMENTS.

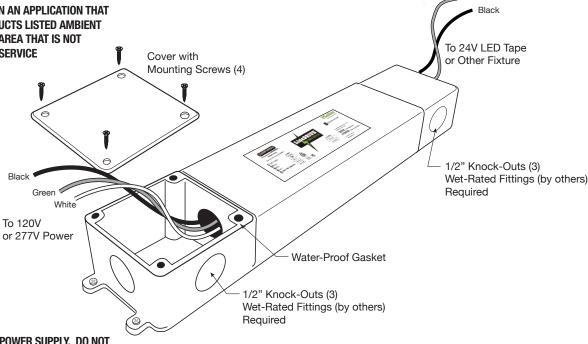



THIS IS A WET LOCATION POWER SUPPLY. DO NOT SUBMERGE IN WATER.

REFER TO DIAGRAMS AT RIGHT FOR COMPONENT IDENTIFICATION AND PROPER MOUNTING AND CONNECTING TO 24V LIGHTING FIXTURES.

- **1. MOUNTING.** Remove Knock-Outs and use wet-rated fittings (by others). Mount LD-EDWP Power Supply Horizontally, a minimum of 12" from the ground. **(FIG. 1)**
- 2. CONNECTING TO 24V LED TAPE OR OTHER 24V FIXTURES. Connect Red and Black leads coming from power supply to Red and Black leads coming from tape. Use wire nuts (by others) or GM Lighting SureTiteTM connectors to insure a reliable connection. (FIG. 2).
- **3. CONNECTING TO LINE VOLTAGE.** Use white for hot, black for negative and green for ground to connect power supply to 120V/277V power. **(FIG. 3).**

MOUNT TAPE OR FIXTURES ACCORDING TO MANUFACTURERS SPECIFICATIONS.

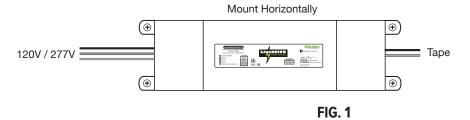

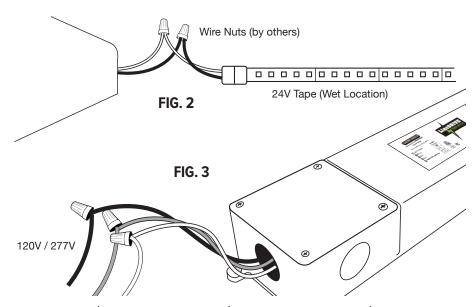



©2022 GM Lighting Specifications are subject to change without notice.

18700 Ridgeland Ave. Tinley Park, IL 60477

Toll-Free: (866) 671-0811 FAX: (708) 478-2640 www.gmlighting.net tech@gmlighting.net